

## **INFORMATION:**

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- Classification report FIRES-CR-259-25-AUPE

## cPVC Pipe on Flexible Wall th. ≥ 75 mm

APPLICATION:

**CFS-FIL** 

01

ID.

DATE:


CFS-FIL:

FW/RW-75-M-01

11/2025

Fire Rating: up to El 60 U/C

**Page 1/1** 

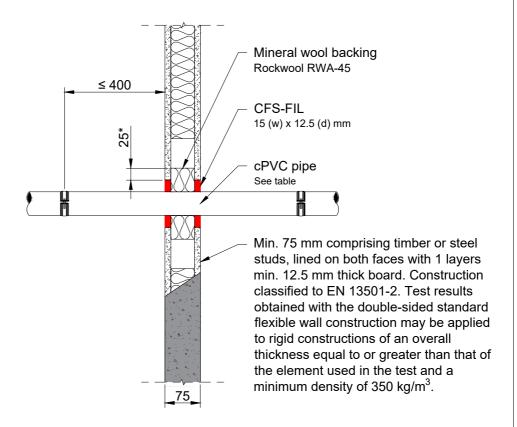

## Notes:

- (\*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- Maximum distance to 1st rigid support: ≤ 400 mm
- Distances between service openings ≥ 50 mm
- Annular gap 15 mm
- Distance between Hilti CFS-FIL and seal edge 15 mm

Brand and type	Pipe diameter	Wall thickness	Classification	
Viking plastics, BlazeMaster pipe	Ø 26,7	2,24	EI 60 U/C	
	Ø 33,4	2,7	EI 60 U/C	
	Ø 42,2	3,4	EI 45 U/C	E 60 U/C
	Ø 48,3	4,15	EI 45 U/C	E 60 U/C
Spears, FlameGuard	Ø 26,7	2,0	EI 45 U/C	E 60 U/C
	Ø 33,4	2,5	EI 60 U/C	
	Ø 42,2	3,1	EI 30 U/C	E 60 U/C
	Ø 48,3	3,6	EI 45 U/C	E 60 U/C

<sup>1.</sup> The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the Bs 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.