

Metal Conduits in Flexible Wall th. ≥ 75 mm

APPLICATION:

CFS-IS: **FW/RW-M-08**

DATE:

INFORMATION:

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- Classification report FIRES-CR-259-25-AUPE

CFS-IS


01

ID.

11/2025

Fire Rating: EI 30 C/U - E 60 C/U

Page 1/1

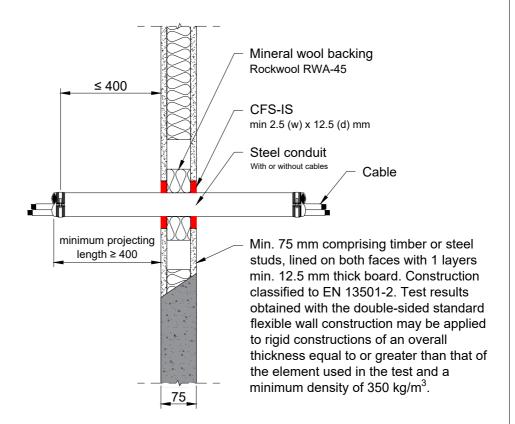

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- Maximum distance to 1st rigid support: ≤ 400 mm
- Maximum seal size (150 x 150) mm (width x height)
- Distances between service openings ≥ 100 mm
- Annular gap ≥ 2.5 mm

Service	Classification
All single rigid steel or stainless-steel conduits up to an outer diameter of 25 mm and wall thickness ≥ 1.6 mm including cables or empty. Conduits of type "projecting" with a seal inside the conduits at one end in practice are covered, minimum projecting length ≥ 400 mm. All sizes of cables currently and commonly used in building practice in Europe including optical fibre cables fitting into the conduit may be used in practice, subject to electrotechnical rules. Coaxial cables may be used up to a diameter fitting the conduit. Non-sheathed cables (wires) are not covered.	EI 30 C/U E 60 C/U

^{1.} The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service

^{2.} The product and application has been assessed as a minimum to the BS 476 standard. If may have additional European and worldwide testing. Please contact Hill for further information 3. All installations should be carried out in accordance with Hilli's installation instructions and by competent & experienced installers using Hilli branded products.

4. All services are to be correctly and adequately supported to prevent collapse and distortion.